

### Electrical Test Program - Preparation for Test (Central Locking)


#### Preparation for Test:

1. **Model 202 up to 11/94:** Check fuse F3–33 ok,
2. **Model 202 as of 12/94:** Check fuse F1–27 ok,
3. Provide access to PSE control module (A37/4, A37/5).
4. Connect socket box with test cable according to connection diagram, see 22, Figure 1.

#### Electrical Wiring Diagrams


See Electrical Troubleshooting Manual, Model 202, Volume 2, group 80

#### Special Tools

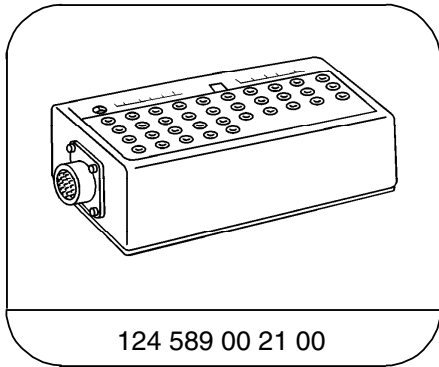


124 589 00 21 00

35-pin socket box

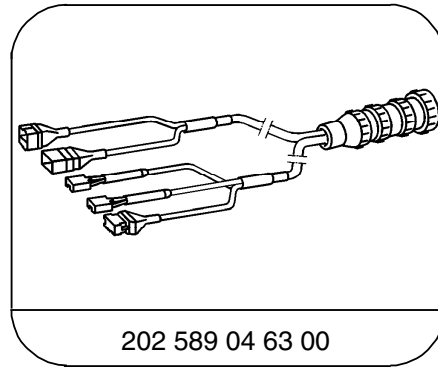

202 589 04 63 00

14-pin test cable

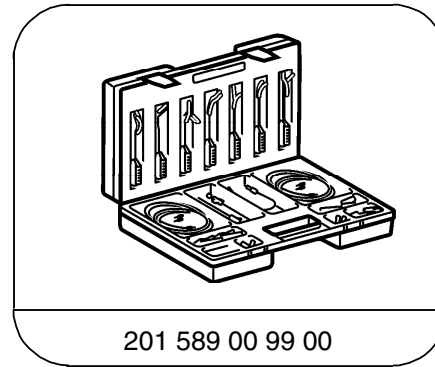

201 589 00 99 00

Electrical connecting set

#### Conventional tools, test equipment

Description	Brand, model, etc.
Multimeter <sup>1)</sup>	Fluke models 23, 83, 85, 87

<sup>1)</sup> Available through the MBUSA Standard Equipment Program.

#### Electrical Test Program - Preparation for Test (Central Locking)

#### Connection Diagram - Socket Box

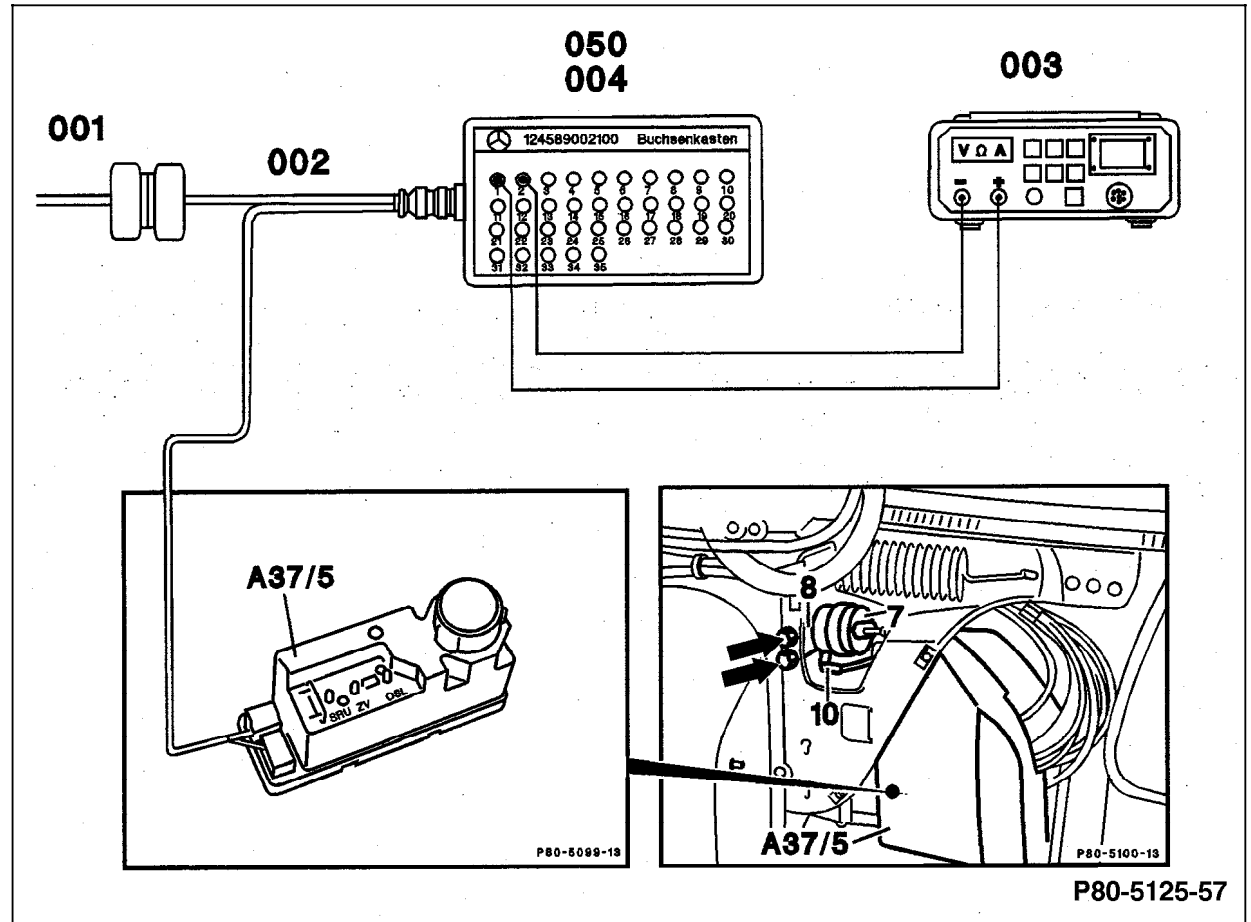


Figure 1

- 001 PSE control module connector
- 002 Test cable
- 003 Multimeter
- 004/050 Socket box (35-pole)
- A37/5 PSE control module

P80-5125-57