

Pneumatic Test Program – Component Locations

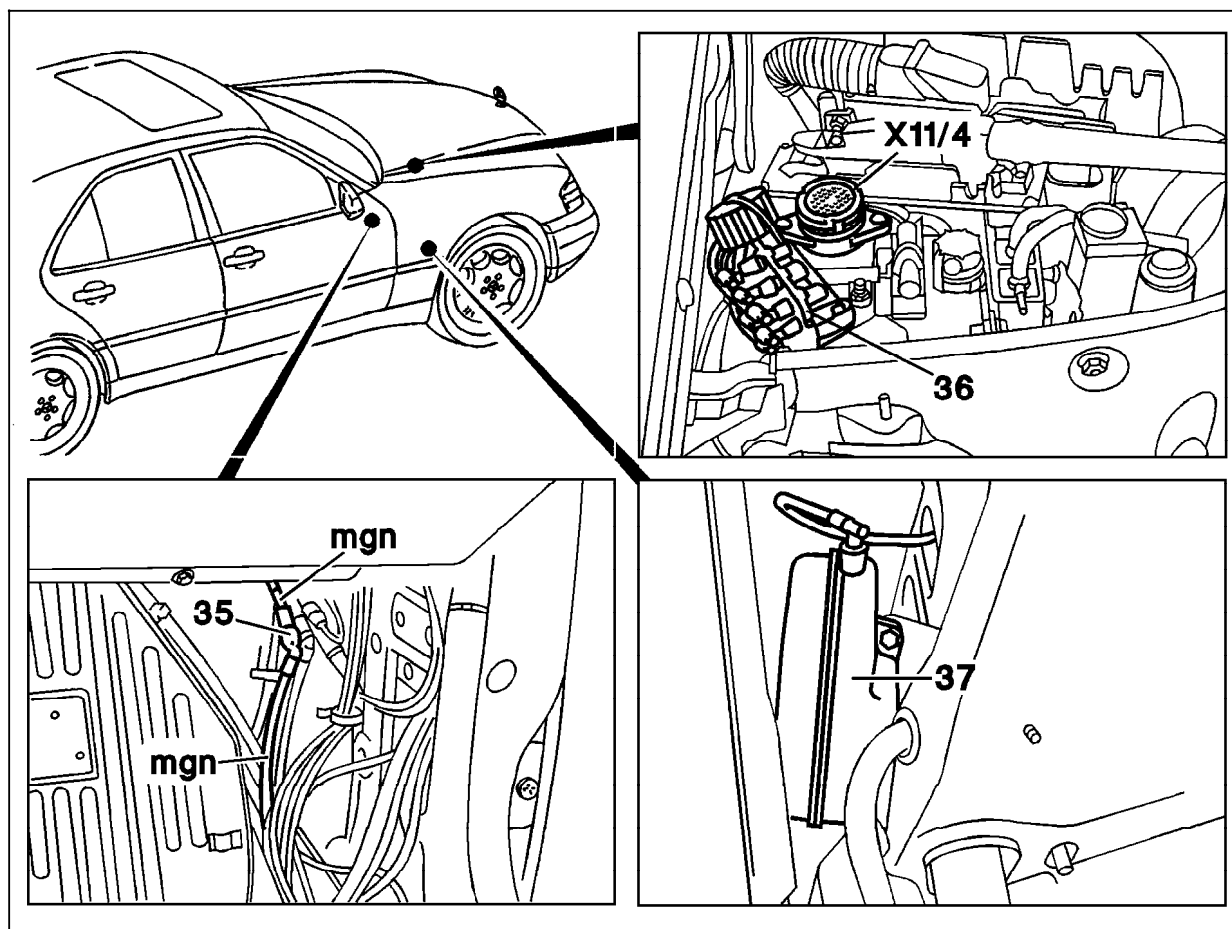


Figure 1

- 35 Separation fitting (right front footwell)
- 36 Vacuum distributor block
- 37 Vacuum reservoir

mgn medium green

P83-5663-57

Pneumatic Test Program – Component Locations

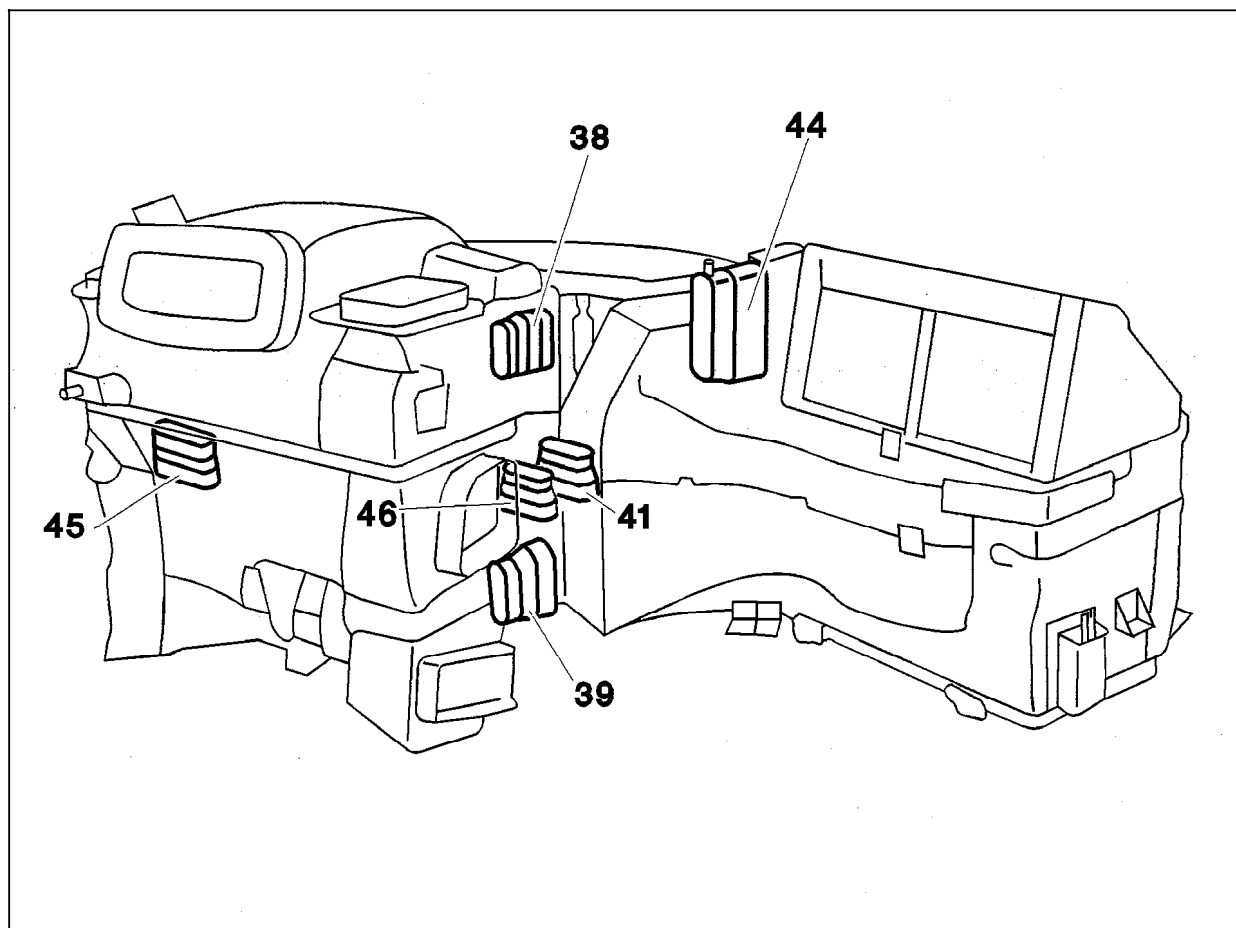


Figure 2

- 38 Defroster flap vacuum element
- 39 Footwell flap vacuum element
- 41 Diverter flap vacuum element
- 44 Fresh/recirculating air flap vacuum element
- 45 Left center outlet tempering flap vacuum element
- 46 Right center outlet tempering flap vacuum element


P83-5639-57

Pneumatic Test Program – Component Locations

Figure 3

- Y11/3 Switchover valve block (8 connections)
- 35 Separation fitting (right front footwell)
- 36 Vacuum distributor block
- 38 Defroster flap vacuum element
- 39 Footwell flap vacuum element
- 41 Diverter flap vacuum element
- 44 Fresh/recirculating air flap vacuum element
- 45 Left center outlet tempering flap vacuum element
- 46 Right center outlet tempering flap vacuum element

hbl	light blue	rt	red
drt	dark red	ws	white
ge	yellow	dgn	dark green
mgn	medium green		

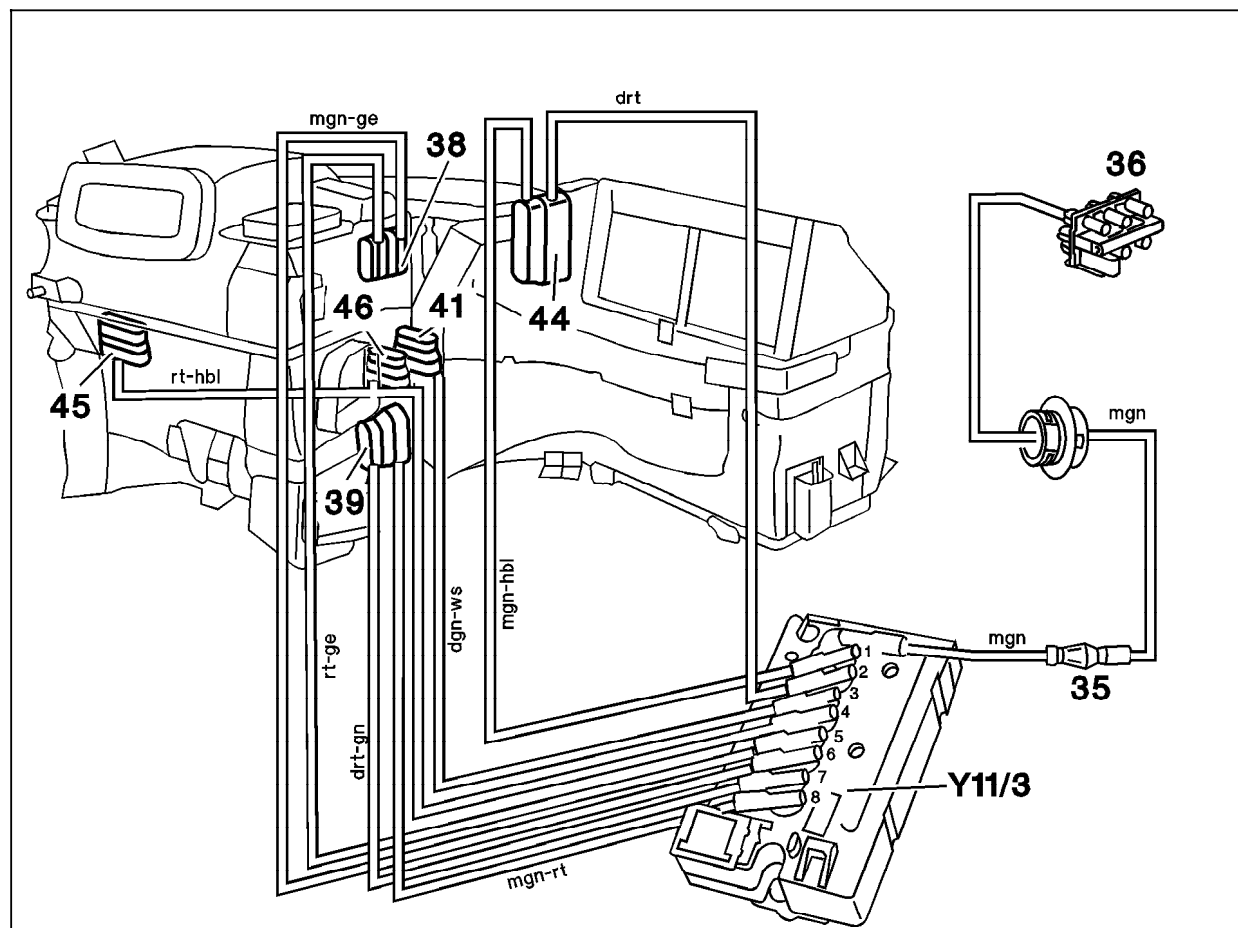

P83-6165-57